

EIKLOR FLAMES® MEASURING

Please call 812.723.3633 after obtaining measurements for sizing recommendations.

Eiklor Flames® gas log systems must be installed in a 'Class A or Masonry' fully-vented solid-fuel fireplace constructed of noncombustible materials with proper throating of flue & open style cap or no cap! Not responsible for chimney spilling.

FRONT VIEW FIREPLACE

A. Front Width: ____

B. Back Width: ____

C. Depth: ____


D. Height: ____

E. Depth Under Chimney: ____


**This should be measured by dropping a plumb bob from behind the lintel straight down to the floor. Measure from that point to the back wall. Burner must be underneath the chimney to prevent spilling.*

F. Gas Line Side: Left or Right

Top View

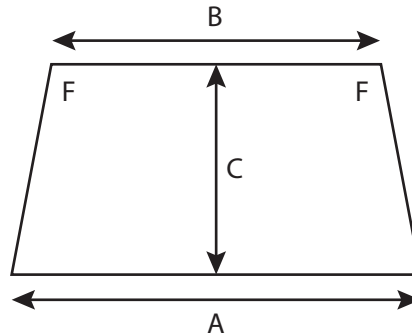

Side View

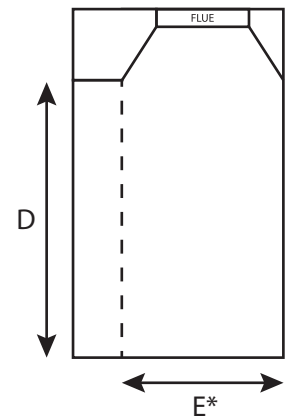

SEE-THRU FIREPLACE

A. Front Width: ____

B. Front Width: ____

C. Depth: ____


D. Height: ____

E. Depth Under Chimney: ____


**This should be measured by dropping a plumb bob from behind each lintel straight down to the floor. Measure between those points (inside ashlip if applicable). Burner must be underneath the chimney to prevent spilling.*

F. Gas Line Location: Same Side or Opposite

Top View

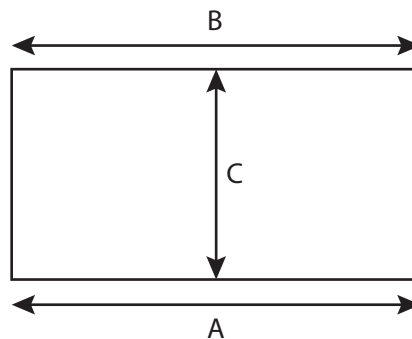

Side View

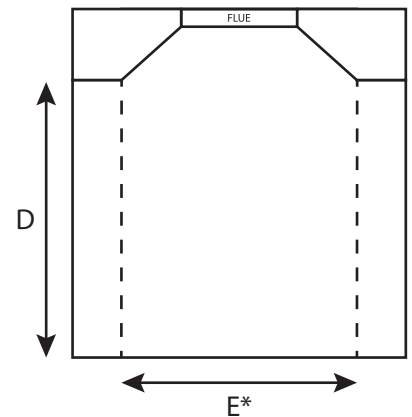


FIREPITS & CAMPFIRES

A. Firepit Inner Diameter/Diagonal: ____

B. Outdoors and Uncovered: Yes or No

Top View - Circle



Top View - Square

